



Member of the FM Global Group

Approval Standard for Centrifugal Fire Pumps Split-Case Type (Axial or Radial)

Class Number 1311

August 2007

Foreword

The FM Approvals certification mark is intended to verify that the products and services described will meet FM Approvals' stated conditions of performance, safety and quality useful to the ends of property conservation. The purpose of Approval Standards is to present the criteria for FM Approval of various types of products and services, as guidance for FM Approvals personnel, manufacturers, users and authorities having jurisdiction.

Products submitted for certification by FM Approvals shall demonstrate that they meet the intent of the Approval Standard, and that quality control in manufacturing shall ensure a consistently uniform and reliable product. Approval Standards strive to be performance-oriented. They are intended to facilitate technological development.

For examining equipment, materials and services, Approval Standards:

- a) must be useful to the ends of property conservation by preventing, limiting or not causing damage under the conditions stated by the Approval listing; and
- b) must be readily identifiable.

Continuance of Approval and listing depends on compliance with the Approval Agreement, satisfactory performance in the field, on successful re-examinations of equipment, materials, and services as appropriate, and on periodic follow-up audits of the manufacturing facility.

FM Approvals LLC reserves the right in its sole judgment to change or revise its standards, criteria, methods, or procedures.

Table of Contents

1. INTRODUCTION	1
1.1 Purpose	1
1.2 Scope	1
1.3 Basis for Requirements	1
1.4 Basis for Approval.....	2
1.5 Basis for Continued Approval	2
1.6 Effective Date.....	2
1.7 System of Units	3
1.8 Applicable Documents	3
1.9 Definitions	3
2. GENERAL INFORMATION.....	6
2.1 Product Information	6
2.2 Approval Application Requirements	6
2.3 Requirements for Samples for Examination.....	7
3. GENERAL REQUIREMENTS.....	7
3.1 Review of Documentation.....	7
3.2 Physical or Structural Features	7
3.2.1 Pump.....	7
3.2.2 Pump Package	7
3.2.3 Pump Casing.....	8
3.2.4 Water Passages.....	8
3.2.5 Impeller	8
3.2.6 Shaft	8
3.2.7 Shaft Seals	9
3.2.8 Bearings.....	11
3.2.9 Coupling	11
3.2.10 Baseplate (Vertically Mounted Pumps Only).....	11
3.2.11 Circulation Relief Valve.....	12
3.3 Materials.....	12
3.4 Markings.....	12
3.5 Manufacturer's Installation and Operation Instructions.....	13
3.6 Calibration	13
3.7 Tolerances	13
4. PERFORMANCE REQUIREMENTS	14
4.1 Design and Calculation Review	14
4.2 Performance	14
4.3 Suction Lift.....	15
4.4 Flange and Gasket Tightness.....	15
4.5 Hydrostatic Strength.....	16
4.6 Endurance Test (Vertically Mounted Pumps Only)	16
4.7 One Hour Test (Mechanical Seal Pumps Only)	16
4.8 Test Procedure.....	17
4.9 Additional Tests	17
5. OPERATIONS REQUIREMENTS	17
5.1 Demonstrated Quality Control Program.....	17
5.2 Facilities and Procedures Audit (F&PA).....	19
5.3 Manufacturer's Responsibilities.....	19
5.4 Manufacturing and Production Tests.....	20
5.4.1 Test Requirement No. 1 - <i>Performance Test</i>	20
5.4.2 Test Requirement No. 2 - <i>Leakage Test</i>	20

APPENDIX A: Units of Measurement	21
APPENDIX B: FM Approvals Certification Marks	22
APPENDIX C: Test Procedures	24
C.1 Capacity Measurements	24
C.1.1 Weight	24
C.1.2 Volume	24
C.1.3 Venturi.....	24
C.1.4 Nozzles	24
C.1.5 Orifice Plate.....	25
C.1.6 Weir	25
C.1.7 Electromagnetic Flow Meters.....	26
C.2 Head Measurements	26
C.3 Power Measurements	26
C.4 Speed Measurement	27
C.5 Time Measurement.....	27
APPENDIX D: Fire Pump Unit (Packages)	28
APPENDIX E: Tolerance	29
APPENDIX F: Figures	30
Figure F-1. Axial Split-Case Centrifugal Fire Pump (Shown with Mechanical Seals).....	30
Figure F-2. Radial Split-Case Centrifugal Fire Pumps (Shown with Mechanical Seals).....	31
APPENDIX G: Sample Listing	32

1. INTRODUCTION

1.1 Purpose

- 1.1.1 This standard states Approval criteria for horizontal (axial) or vertical (radial), split-case type, centrifugal fire pumps that supply water to fire protection systems. These pumps must be available for many years to operate reliably at rated capacities and pressures during emergency fire incidents, despite being idle for extended periods.
- 1.1.2 Approval criteria may include, but are not limited to, performance requirements, marking requirements, examination of manufacturing facility(ies), audit of quality assurance procedures, and a follow-up program.

1.2 Scope

- 1.2.1 This standard encompasses the design and performance requirements for horizontal (axial) or vertical (radial), split-case type, centrifugal fire pumps for use in fire protection systems. Approval is limited to horizontal (axial) or vertical (radial), split-case type, centrifugal pumps which have a rated pressure of at least 40 psi (275 kPa). In cases where metric sized centrifugal fire pumps are to be examined for Approval, test criteria comparable to the United States equivalent size shall be used.
- 1.2.2 This standard encompasses the requirements for single and multistage split-case fire pumps.
- 1.2.3 Requirements for other types of centrifugal fire pumps are detailed in the following Approval Standards:

<i>Class</i>	<i>Pump Type</i>
1312	Vertical Shaft Turbine Type
1319	Horizontal End-Suction Type
1370	Vertical Turbine Barrel Type
1371	In-Line Type

- 1.2.4 Requirements for other major components in the pump package are detailed in the following Approval Standards:

<i>Class</i>	<i>Equipment</i>
1046	Fire Pump Flowmeter Systems
1321/1323	Controllers for Electric Motor Driven and Diesel Engine Driven Fire Pumps
1333	Diesel Engine Fire Pump Drivers
1359	Trim Water Pressure Relief Valves
2311	Pressure Gauges for Fire Protection Systems

- 1.2.5 Approval Standards are intended to verify that the product described will meet stated conditions of performance, safety, and quality useful to the ends of property conservation.

1.3 Basis for Requirements

- 1.3.1 The requirements of this Standard are based on experience, research and testing, and/or the standards of other organizations. The advice of manufacturers, users, trade associations, jurisdictions and/or loss control specialists was also considered.

- 1.3.2 The requirements of this Standard reflect tests and practices used to examine characteristics of horizontal (axial) or vertical (radial), split-case type, centrifugal fire pumps for the purpose of obtaining Approval. Horizontal (axial) or vertical (radial), split-case type, centrifugal fire pumps having characteristics not anticipated by this Standard may be FM Approved if performance equal, or superior, to that required by this Standard is demonstrated, or if the intent of the Standard is met. Alternatively, horizontal (axial) or vertical (radial), split-case type, centrifugal fire pumps which meet all of the requirements identified in this Standard may not be FM Approved if other conditions which adversely affect performance exist or if the intent of this Standard is not met.

1.4 Basis for Approval

Approval is based upon satisfactory evaluation of the product and the manufacturer in the following major areas:

- 1.4.1 Examination and tests on production samples shall be performed to evaluate
- The suitability of the product
 - The performance of the product as specified by the manufacturer and required by FM Approvals; and as far as practical,
 - The durability and reliability of the product.
- 1.4.2 An initial Facilities and Procedures Audit shall be conducted to evaluate the manufacturer's ability to consistently produce the product that was examined and tested as part of the Approval examination. The audit shall review the facility and in-place quality control procedures used in the manufacture of the product. Typically, areas of review are incoming inspection, work in progress, production testing, final quality control, marking, calibration of equipment, shipping procedures, and document and drawing control. These examinations are repeated as part of FM Approval's product follow-up program. (Refer to Section 5.2, Facility and Procedures Audit.)

1.5 Basis for Continued Approval

- 1.5.1 Continued Approval is based upon:
- Production or availability of the product as currently FM Approved;
 - The continued use of acceptable quality assurance procedures;
 - Satisfactory field experience;
 - Compliance with the terms stipulated in the Master Agreement;
 - Satisfactory re-examination of production samples for continued conformity to requirements; and
 - Satisfactory Facilities and Procedures Audits (F&PAs) conducted as part of FM Approvals' product follow-up program.
- 1.5.2 Also, as a condition of retaining Approval, manufacturers may not change an FM Approved product or service without prior authorization by FM Approvals. (Refer to Section 5.1.3 for further details regarding changes.)

1.6 Effective Date

The effective date of an Approval standard mandates that all products tested for Approval after the effective date shall satisfy the requirements of that standard. Products FM Approved under a previous edition shall comply with the new version by the effective date or forfeit Approval.

The effective date of this Standard is **August 31, 2008** for full compliance with all requirements.

1.7 System of Units

Units of measurement used in this Standard are United States (U.S.) customary units. These are followed by their arithmetic equivalents in International System (SI) units, enclosed in parentheses. The first value stated shall be regarded as the requirement. The converted equivalent value may be approximate. Appendix A lists the selected units and conversions to SI units for measures appearing in this standard. Conversion of U.S. customary units is in accordance with the Institute of Electrical and Electronics Engineers (IEEE)/American Society for Testing Materials (ASTM) SI 10-2002, *American National Standard for Use of the International System of Units (SI): The Modern Metric System*. One unit of measurement (Liter), outside of, but recognized by SI, is commonly used in international fire protection and is used in this standard.

1.8 Applicable Documents

The following standards, test methods, and practices are referenced in this standard or beneficial in understanding this standard.

- ANSI/Hydraulics Institute (HI), ANSI/HI 1.1-1.2 (M101) - 2000, *Centrifugal Nomenclature*
- ANSI/HI 1.3 (M102) - 2000, *Centrifugal Applications*
- ANSI/HI 1.4 (M103) - 2000, *Centrifugal Operations*
- ANSI/HI 1.6 (M104) - 2000, *Centrifugal Tests*
- ANSI/HI 3.1-3.5 (M109) - 2000, *American National Standard for Rotary Pumps for Nomenclature, Definitions, Applications, and Operation*
- ANSI/HI 3.6 (M110) - 2000, *American National Standard for Rotary Pump Tests*
- ANSI/HI 4.1-4.6 (M111) - 2000, *American National Standard for Sealless Rotary Pumps for Nomenclature, Definitions, Applications, and Operations*
- American Petroleum Institute (API) Standard 682/ISO 21049 - *Pumps—Shaft Sealing Systems for Centrifugal and Rotary Pumps*
- FM Approvals' Approval Standards
- FM Global Property Loss Prevention Data Sheet 2-81, January 2006, *Fire Safety Inspections and Sprinkler System Maintenance*
- FM Global Property Loss Prevention Data Sheet 3-7N, September 2001, *Stationary Pumps for Fire Protection*
- IEEE/ASTM SI 10-2002, *American National Standard for Use of the International System of Units (SI): The Modern Metric System*
- National Fire Protection Association (NFPA) NFPA 20, 2007, *Standard for the Installation of Stationary Pumps for Fire Protection*
- NFPA 25, 2002, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*

1.9 Definitions

For purposes of this standard, the following terms apply:

Accepted

This term refers to installations acceptable to the authority enforcing the applicable installation rules. When the authority is FM Global, such locations are termed "FM Global Accepted." Acceptance is based upon an overall evaluation of the installation. Factors other than the use of FM Approved equipment impact upon the decision to accept, or not to accept. Acceptance is not a characteristic of a product. A product accepted for one installation may not be acceptable elsewhere. (Contrast with FM Approved.)

Axial Split-Case Centrifugal Fire Pump

A pump with the shaft in a horizontal position, with a housing which is split in a horizontal plane through the shaft centerline for easy maintenance and in which the pressure is developed by the action of centrifugal force. The term horizontal split-case is also used.

Corrosion Resistant

Having resistance to corrosion equal to or exceeding that of bronze alloy having a minimum copper content of 80 percent, or is of Series 300 Stainless Steel construction.

Design Working Pressure

The maximum pressure for which a pump component is designed. This pressure is equal to or greater than the maximum pressure developed by the pump at shut off or churn conditions with the largest impeller available, plus the maximum suction pressure for the pump.

Efficiency

The ratio of the energy delivered by the pump to the energy supplied to the pump shaft (liquid power divided by applied power).

Enclosed Impeller

An impeller in which the pumped liquid is confined by the sidewalls (shrouds) and vanes of the impeller.

FM Approvals Certification Mark

The FM Approvals Certification Mark is detailed in Appendix B. Their use is mandatory on all units of FM Approved split-case pumps. These registered marks cannot be used except as authorized by FM Approvals via the granting of Approval to a specific product.

FM Approved

This term refers to products FM Approved by FM Approvals. Such products are listed in the Approval Guide, a publication of FM Approvals, issued three times per year. All products so listed have been successfully examined by FM Approvals, and their manufacturers have signed and returned a Master Agreement to FM Approvals. These forms obligate the manufacturer to allow re-examination of the product and audit of facilities and procedures at FM Approval's discretion. It further requires the manufacturer not to deviate from the FM Approved configuration of the product without review by and agreement of FM Approvals.

Maximum Power

The greatest speed-corrected power required to drive the pump at rated speed and at any point along its characteristic curve, and through the pumps total run out condition. This is determined under conditions of increasing positive suction head.

Mechanical Seals

A sealing device which forms a running seal between the rotating and stationary components. They may be used in place of compression (soft) packing. All mechanical seals are constructed of three basic sets of parts:

- A set of primary seal faces: one rotary and one stationary
- A set of secondary seals known as shaft packings and insert mountings such as O-rings, wedges and V-rings
- Mechanical seal hardware including gland rings, collars, compression rings, pins, springs and bellows

The primary seal is achieved by two very flat, lapped faces perpendicular to the shaft. The rubbing contact between these two flat mating surfaces minimizes leakage. One face is held stationary in a housing and the other face is fixed to, and rotates with, the shaft. Dissimilar materials are usually used for the stationary insert and the rotating seal ring face in order to prevent adhesion of the two faces.

Cartridge Seal Type

This type of mechanical seal is a completely self-contained unit (including stationary and rotating seal faces, gland sleeve, mating ring, etc.) which is pre-assembled and preset before installation. The cartridge mechanical seal is a complete seal assembly which is manufactured, assembled and calibrated by the mechanical seal manufacturer.

Component Type

This type of mechanical seal is assembled from the individual components directly onto the shaft. The components usually consist of a rotating unit with a mating face which is in contact with a stationary unit. The rotating unit seals in two places, at the interface between the rotating face and stationary and between the shaft and the seal body. The stationary unit seals against the pump body.

Split Seal Type

This type of mechanical seal has its primary sealing elements and other components split. The seal can be mounted on a pump with out removing the impeller.

Multiple Stage Pumps

Horizontal split-case, centrifugal fire pumps with more than one impeller on the same shaft. The number of stages is determined by the number of impellers.

Radial Split-Case Centrifugal Fire Pumps

Radial split-case centrifugal fire pumps are pumps with the shaft in a horizontal position, with a housing which is split in a plane perpendicular to the axis of rotation. The term vertically split is also used.

Rated Capacity

Capacity in gallons per minute - gal/min (liter/min - L/min), at rated pressure and speed.

Rated Pressure

Pressure in pounds per square inch - psi (kilopascals -kPa) developed by the pump when operating at rated capacity and speed.

Shutoff or Churn Pressure

The net pressure in psi (kPa) developed by the pump at rated speed with zero flow.

Single Stage Pump

A pump in which the total head is developed by one impeller.

Stuffing Box Packing

Typically an arrangement consisting of rings of packing, a lantern ring for the injection of a lubricating and/or flushing liquid, and a gland to hold the packing and maintain the desired compression for a proper seal. The function of packing is to control leakage it is not intended to eliminate it completely. The packing is lubricated by the pumped liquid. The lantern ring is supplied for situations where the stuffing box pressure is below atmospheric pressure, to inject lubrication into the stuffing box by the use of a bypass line from the pump discharge to the lantern ring connection.

Total Discharge Head

The gauge reading in psi (kPa) at the discharge flange of the pump, referred to the pump centerline, plus the velocity head at the point of gauge attachment.

Total Suction Head

The condition when the suction pressure is above atmospheric. The total suction head is the algebraic sum of the gauge reading in psi (kPa) at the pump suction flange, referred to the pump centerline, and the velocity head at the point of gauge attachment. Also called "positive suction pressure."

Total Suction Lift

The condition when suction pressure is below atmospheric. The total suction lift is the algebraic sum of the gauge reading in psi (kPa) at the suction flange of the pump, referred to the pump centerline, and the velocity head at the point of gauge attachment.

Total Head

The algebraic difference between the total discharge head and the total suction head. Where suction head exists, total head equals total discharge head minus total suction head. Where suction lift exists, total head equals total discharge head plus total suction lift.

Vertical Mounted Split-Case Centrifugal Fire Pump

A pump with the shaft in a vertical position, with a housing which is split parallel to the shaft for easy maintenance and in which the pressure is developed by the action of centrifugal force.

2. GENERAL INFORMATION

2.1 Product Information

2.1.1 Pumps covered by this standard include those designed for one of the following capacities: 25, 50, 100, 150, 200, 250, 300, 400, 450, 500, 750, 1000, 1250, 1500, 2000, 2500, 3000, 3500, 4000, 4500, 5000 gal/min (95, 190, 380, 570, 755, 945, 1135, 1515, 1705, 1895, 2840, 3785, 4730, 5680, 7570, 9465, 11 355, 13 250, 15 140, 17 035, 18 925 L/min) or larger. Pumps designed for other rated capacities shall be evaluated on a case-by-case basis.

2.1.2 Pumps shall have a minimum rated pressure of at least 40 psi (275 kPa).

2.1.3 In order to meet the intent of this Standard, split-case type, centrifugal fire pumps must be examined on a model-by-model, type-by-type, manufacturer-by-manufacturer, and plant-by-plant basis. This is predicated on the basis that identical designs, fabricated in identical materials by different manufacturers or, even by different plants of the same manufacturer, have been seen to perform differently in testing. Sample fire pumps, selected in conformance to this criterion, shall satisfy all of the requirements of this Standard.

2.2 Approval Application Requirements

To apply for an Approval examination the manufacturer, or its authorized representative, should submit a request to:

Hydraulics Group Manager
FM Approvals Hydraulics Laboratory
743A Reynolds Road
West Glocester, RI 02814 U.S.A.

The manufacturer shall provide the following preliminary information with any request for Approval consideration:

- A complete list of all models, types, sizes, and options for the products or services being submitted for Approval consideration;
- Anticipated pump performance, including total head, power requirements, and efficiency versus flow characteristics. If different impellers or a range of impellers are used to obtain the rated head range for the pump being examined, complete details shall be provided concerning the range of performance specifications to be evaluated;
- Calculations to determine shaft size, casing bolt size, and anti-friction bearing life;

- If mechanical seals are provided, all sizing and design information shall be submitted for evaluation, (See Section 3.2.7)
- General assembly drawings (showing the pump and attachments), one complete set of manufacturing drawings, materials list(s) and physical property specifications, anticipated marking format, brochures, sales literature, specification sheets, installation, operation and maintenance procedures;
- The number and location of manufacturing facilities and,
- All documents shall identify the manufacturer's name, document number or other form of reference, title, date of last revision, and revision level. All foreign language documents shall be provided with English translation.

2.3 Requirements for Samples for Examination

Following set-up and authorization of an Approval examination, the manufacturer shall submit samples for examination and testing. Sample requirements are to be determined by FM Approvals following review of the preliminary information. Sample requirements may vary depending on design features, results of prior testing, and results of the foregoing tests. It is the manufacturer's responsibility to submit samples representative of production. Any decision to use data generated utilizing prototypes is at the discretion of FM Approvals. The manufacturer shall provide the test facilities, which are required to evaluate the split-case type, centrifugal fire pumps.

3. GENERAL REQUIREMENTS

3.1 Review of Documentation

During the initial investigation and prior to physical testing, the manufacturer's specifications, technical data sheets, and design details shall be reviewed to assess the ease and practicality of installation and use. The product shall be capable of being used within the limits of the Approval investigation.

3.2 Physical or Structural Features

3.2.1 Pump

Pumps shall be designed for rated capacities equal to or greater than 25 gal/min (95 L/min). Rated pump pressures shall be at least 40 psi (275 kPa). Castings shall be free of defects which could make them unfit for their intended use. Flange dimensions, bolt layouts, and threaded openings used in pipe connections shall conform to a recognized national or international standard. Two or more pump ratings may be assigned to a single characteristic curve; however, the maximum power requirements used in selecting a driver shall be based on the highest power requirement, regardless of where it occurs on the entire characteristic curve.

3.2.2 Pump Package

The manufacturer of the pump shall be able to supply the necessary pump accessories (See Appendix D) to provide a complete pump installation, as detailed in FM Global Property Loss Prevention Data Sheets. The pump manufacturer shall be held accountable for the complete pump package (as detailed in Appendix D), and satisfactory performance of the "Field Acceptance Test" for any pump bearing the FM Approvals Certification Mark. This accountability only includes proper operation and sizing of the pump and the accessories listed in Appendix D, the pump manufacturer shall not be held

accountable for items supplied by others that affect the pump performance, (i.e. wrong piping, insufficient air intake for the pump room, etc.).

This responsibility may be delegated to an authorized agent of the pump manufacturer. This delegation does not relieve the pump manufacturer of their accountability and responsibility for the satisfactory performance of the complete pump package. Delegation to an authorized agent shall be accompanied by a set of assembly construction details from the pump manufacturer and a FM Approvals facilities and procedures audit shall be periodically conducted at the authorized agent's facility to ensure that the manufacturer's instructions are being followed. The authorized agent shall assemble the complete pump package; they shall not sell or release a bare-shafted pump. If the assembly construction details are provided by the authorized agent they shall be signed off (stamped, etc.) by the pump manufacturer.

3.2.3 Pump Casing

The pump casing shall be designed to permit examination and removal of impellers and other interior parts without disturbing suction or discharge piping. A drain opening(s) shall be provided so that all parts of the pump casing can be drained. The opening shall be threaded to receive a corrosion resistant pipe plug at least 1/2 in. nominal size. Renewable casing wearing rings shall be provided. Impeller wear rings may be provided, as an option.

3.2.4 Water Passages

All water passages shall be designed to minimize the possibility of foreign materials becoming lodged in them. The minimum width of these passages at the periphery or at any point within the impeller shall be at least 1/2 in. (12.7 mm) for pumps rated 500 gal/min (1895 L/min) and larger. Passages in pumps having rated capacities of 100 to less than 500 gal/min (380 to less than 1895 L/min) shall be at least 3/8 in. (9.5 mm). Passages in pumps having rated capacities less than 100 gal/min (380 L/min) shall be at least 1/4 in. (6.3 mm).

3.2.5 Impeller

Impellers shall be securely attached in a radial direction to the pump shaft. No impeller shall contact the casing under normal operating conditions. Impellers shall be the closed type. All impellers shall be dynamically balanced. Calculations shall be provided to show that the impeller will not come into contact with the casing at any point on the characteristic curve, including shut-off.

3.2.6 Shaft

Shafts shall be of adequate size and strength to successfully transmit the torques encountered in starting and during operation while supporting the impeller and other rotating parts.

In order to safeguard against shaft failure, the maximum torsional shearing stress, as calculated by the formula below, shall not exceed 30 percent of the elastic limit in tension and 18 percent of the ultimate tensile strength of the shaft material. For shafts with keyways, a further 25 percent reduction is required.

Renewable shaft sleeves shall be provided to adequately safeguard the shaft against wear, erosion, and corrosion. Shaft sleeves shall be of a hard bronze or other corrosion resistant material.

Maximum Torsional Shearing Stress:

English	Metric
$S_s = \frac{3.21 \times 10^5 \times P}{n \times d^3}$	$S_s = \frac{4.86 \times 10^{10} \times P}{n \times d^3}$

Where: S_s - Torsional Shear Stress, psi (kPa)
 P - Maximum Input Power demand, hp (kW)
 n - Rated Speed, r/min
 d - Shaft diameter, in. (mm)

3.2.7 Shaft Seals

3.2.7.1 The shaft seal, soft packing or mechanical seal, shall adequately safeguard against excessive water leakage out of the pump when suction pressure is above atmospheric, and prevent air leakage into the pump when the suction pressure is below atmospheric. Systems shall be designed so that suction pressure is always positive.

3.2.7.2 Mechanical Seals

Use of mechanical seals is restricted to those applications where only clean water is pumped. Clean water shall be free of debris and particles in suspension liable to cause accumulations in the system piping. Water with excessive contaminants can cause accumulations, adhesion, clogging or abrasion which can adversely affect the performance of mechanical seals. Suction supplies shall not be from open bodies of water, e.g., retention ponds, lakes or rivers. The pump shall operate with positive pressure conditions at the pump inlet at all times. Additional information on installation requirements for pumps can be found in FM Global Property Loss Prevention Data Sheets 3-7N, *Stationary Pumps for Fire Protection*. Mechanical seals shall not be used in vertically mounted split-case pumps.

Mechanical seals shall be tested in each pump model; it does not necessarily follow that acceptance of a mechanical seal for one model of pump translates to acceptance for other pump models, even by the same manufacturer. The pump assembly is FM Approved; not the mechanical seal.

Spare parts meeting all the material and design requirements of the new seal shall be supplied by the pump manufacturer and stored on site, and shall include at a minimum: the sealing faces, springs, elastomers, gaskets, and fasteners. Spare parts boxes shall be clearly marked with the shelf life, if applicable.

Complete detailed instructions for the removal and replacement of the mechanical seals shall be included in the manufacturer's maintenance, operation and installation instructions. Prior to shipment of the pump, the manufacturer shall document that the pump's suction supply is not be from open bodies of water and is free of debris and particles in suspension liable to cause accumulations in the system piping.

Mechanical Seals shall meet all the following design requirements:

3.2.7.2.1 Mechanical seals of the component, cartridge, and split types shall be acceptable.

- 3.2.7.2.2 Seals shall be designed by the seal manufacturer and shall be used in strict accordance with the seal manufacturer's specifications for pressure; peripheral velocity; seal face squareness; seal chamber concentricity; and shaft deflection and alignment. The seals shall be suitably matched to the pump characteristics.
- 3.2.7.2.3 The seal shall be suitable for the vacuum level which may be experienced during startup to prevent air from leaking into the system. This shall be verified during Suction Lift testing. Seal faces shall be mechanically loaded to prevent leakage when the pump is not running.
- 3.2.7.2.4 Hydraulically balanced seals shall be used to reduce heat generation and face wear.
- 3.2.7.2.5 A secondary containment element, such as a segmented floating bushing, shall be used behind the seal faces of the mechanical seal. The secondary containment element shall prevent flow of water towards the motor, and allow pumping pressure to develop in the event of mechanical seal failure.
- 3.2.7.2.6 Primary sealing faces shall be either:
- Resin impregnated carbon graphite on silicon carbide or tungsten carbide, or
 - Silicon carbide on silicon carbide
 - Other material combinations with equivalent or superior wearing properties shall be evaluated on a case-by-case basis.
- The sealing surfaces shall be of such flatness as to allow pumps to remain visibly leak-free at the seals through all phases of testing.
- 3.2.7.2.7 Secondary sealing elastomers shall be ethylene-propylene or fluorocarbon rubbers or of materials equivalent to or superior to the properties of these materials.
- 3.2.7.2.8 Glands, drive holder, segmented bushing, and miscellaneous parts shall be made of corrosion resistant materials equivalent to or greater than 304 stainless steel.
- 3.2.7.2.9 Seal loading springs shall either be isolated from the pumped liquid or shall be of the single spring design to prevent clogging and corrosion which may affect seal loading. Springs isolated from the pumped fluid shall have corrosion characteristics equivalent to 304 stainless steel or greater. Springs in contact with the pumped fluid or of multiple spring designs shall be fabricated of Hastelloy C alloy or materials of equivalent or greater corrosion resistance.
- 3.2.7.2.10 Two ports with tapped connections shall be provided to allow for flushing. The seal shall be flushed using circulation from the pump discharge to facilitate heat removal, venting, and to remove solids accumulation. A minimum vapor pressure margin of 30 psi (205 kPa) at the maximum operating temperature shall be maintained. The seal shall be applied with discharge recirculation. An example of a discharge recirculation piping plan can be found in API Piping Plan 11, API Std 682/ISO 21049 - *Pumps—Shaft Sealing Systems for Centrifugal and Rotary Pumps*.

- 3.2.7.2.11 The compatibility between the mechanical seal specifications and tolerance data and the pump specifications shall be verified. This compatibility shall be verified for the most extreme expected operating conditions, (Shut-off and maximum flow) and for the full range of speeds and impeller diameters. This shall include radial thrust calculations showing that the shaft deflection, at rated capacity, shut-off and maximum capacity, does not exceed the mechanical seal allowances.

Radial thrust shall be calculated as follows, (shown for shut-off calculation):

$$R_{SO} = K_{so} \times \left[\frac{H_{so} \times S}{2.31} \right] \times D_2 \times B_2 \quad \text{(English units)} \quad R_{SO} = 9810 \times (K_{so} \times H_{so} \times S \times D_2 \times B_2) \quad \text{(SI units)}$$

Where:

- R_{so} - radial thrust at shutoff, lb (N)
- K_{so} - thrust factor at shutoff, from Hydraulics Institute Standards, dimensionless
- H_{so} - total head of pump at shutoff, ft of H₂O (m of H₂O)
- S - specific gravity of fluid (fresh water = 1), dimensionless
- D₂ - diameter of impeller, in. (m)
- B₂ - width of impeller at discharge, including shrouds, in. (m)

3.2.8 Bearings

Suitable bearings shall be provided to ensure smooth, low friction rotation of the impeller shaft. When anti-friction bearings are used, they shall be designed to withstand the maximum radial and thrust loads encountered during maximum load conditions. Water slingers and dust caps or other suitable means of preventing water or other foreign matter from entering the bearings shall be provided.

To provide adequate durability, anti-friction bearings shall have the following features:

- A minimum calculated life rating of not less than 5000 hours at maximum load;
- Arrangement to float axially on one or both ends;
- Grease lubrication, with a grease fitting and relief hole if lubrication is necessary.

Calculations shall be provided to verify the bearing life exceeds the 5000 hour requirements. Drawings of the impeller(s), shaft and shaft sleeves shall identify weights of these components.

3.2.9 Coupling

Couplings between the fire pump and the pump driver shall not be of the All-Elastomeric Type. Couplings that utilize elastomeric components are acceptable as long as the elastomeric component is not the only means of power transmission. Examples of these couplings are: pin and bushing, steel flex grid, jaw-type, and drive shafts. Couplings shall be of the proper size for the application.

3.2.10 Baseplate (Vertically Mounted Pumps Only)

The baseplate of horizontal split-case centrifugal fire pumps shall be suitably designed to support the pump and motor without excessive vibration or visible distortion. Calculations will be required to show the baseplate is adequately designed to support the horizontal split-case centrifugal fire pump mounted and installed in the vertical position.

3.2.11 Circulation Relief Valve

Each pump shall have a circulation relief valve listed for the fire pump service installed and set below the shutoff pressure at minimum expected suction pressure. This valve is usually found on the pump casing but may be installed on the discharge side of the pump before the discharge check valve. It shall provide flow of sufficient water to prevent the pump from overheating when operating with no discharge. Provisions shall be made for discharge to a drain. Circulation relief valves shall not be tied in with the packing box or drip rim drains. Minimum size of the circulation relief valve shall be 3/4 in. NPS for pumps with a rated capacity not exceeding 2500 gpm (9465 L/min) and 1 in. NPS for pumps with a rated capacity of 3000 to 5000 gpm (11,355 to 18,925 L/min). The relief valve shall not be piped to the pump suction or supply connection. Approval requirements for circulation relief valves are discussed in Approval Standard 1359.

Exception: This rule shall not apply to engine-driven pumps for which engine cooling water is taken from the pump discharge.

3.2.12 Miscellaneous components

If fabricated (welded) steel or cast fittings which are not FM Approved are provided by the pump manufacturer as a part of the pump assembly (i.e., suction and discharge adaptors), they shall be evaluated as part of the pump Approval program. This shall normally include a review of detail drawings and hydrostatic tests to at least 700 psi (4825 kPa) or four times the rated working pressure, whichever is greater, for 5 minutes.

3.3 Materials

All materials used in these fire pumps shall be suitable for the intended application. At a minimum, the impellers, impeller wear rings, impeller nut, casing wear rings, water-seal rings, stuffing box gland, gland nut, shaft sleeve, and interior bolts or screws shall be constructed of corrosion resistant materials. Mechanical seals shall be constructed of the materials detailed in Section 3.2.7.2. When unusual materials are used, special tests may be necessary to verify their suitability.

3.4 Markings

3.4.1 A permanently-marked, legible, corrosion-resistant nameplate shall be securely attached to the pump or bedplate where it shall be easily visible. The nameplate shall include the following information:

- Manufacturer's name and address;
- Model or type designation;
- Rated capacity;
- Rated total head;
- Rated speed;
- Maximum power required;
- Impeller diameter(s);
- Pump serial number, and;
- FM Approval's Certification Mark, (see Appendix B).

3.4.2 Pumps that are available with both packing and mechanical seals shall have unique model numbers. The model numbers can be completely different or only slightly changed from one to the other. (i.e. the letter "M" could be added to the end of the model number to design mechanical seals.)

3.4.3 Pumps that are produced at more than one location shall be identified as the product of a particular location.

- 3.4.4 An arrow indicating the direction of pump rotation shall be cast into the pump body. A corrosion resistant metal nameplate bearing the arrow shall be considered acceptable if permanently fastened to the fire pump body.
- 3.4.5 The model or type identification shall correspond with the manufacturer's catalog designation and shall uniquely identify the product as FM Approved. The manufacturer shall not place this model or type identification on any other product unless covered by a separate agreement.
- 3.4.6 The FM Approval's Certification Mark (see Appendix B) shall be displayed visibly and permanently on the product. The manufacturer shall not use these Marks on any other product unless such product is covered by separate agreement with FM Approvals.
- 3.4.7 All markings shall be legible and durable.

3.5 Manufacturer's Installation and Operation Instructions

Maintenance, operation and installation instructions, including any special dimension requirements, shall be furnished by the manufacturer. Instructions shall be provided with each fire pump.

3.6 Calibration

All equipment used to verify the test parameters shall be calibrated within an interval determined on the basis of stability, purpose, and usage of the equipment. A copy of the calibration certificate for each piece of test equipment is required for FM Approvals records, indicating that the calibration was performed against working standards whose calibration is certified as traceable to the National Institute of Standards and Technology (NIST) or to other acceptable reference standards and certified by an ISO 17025 accredited calibration laboratory. The test equipment must be clearly identified by label or sticker showing the last date of the calibration and the next due date. A copy of the calibration service's accreditation certificate as an ISO 17025, "General Requirements for the Competence of Testing and Calibration Laboratories", calibration laboratory is required for FM Approvals records.

The calibration of recently purchased new equipment is also required. Documentation indicating either the date of purchase or date of shipment, equipment description, model and serial number is required for identification. The period from the time the equipment was put into service to the date of testing must be within an interval that does not require the equipment to be calibrated as determined on the basis of the parameters mentioned above.

3.7 Tolerances

Tolerances on units of measure shall be as described in Appendix E, unless otherwise specified.

4. PERFORMANCE REQUIREMENTS

4.1 Design and Calculation Review

4.1.1 Requirement

The pump shall conform to the manufacturer's drawings and specifications and to FM Approvals design and calculation requirements stated in Section 3.

4.1.2 Test/Verification

A sample pump shall be examined and compared to drawings and specifications. It shall be verified that the sample conforms to the physical and structural requirements described in Section 3, General Requirements.

The following calculations shall be reviewed and compared to the requirements stated in Section 3:

- Maximum torsional shearing stress
- Mechanical seal and pump compatibility
- Casing bolt strength
- Bearing life calculations
- Shaft deflection and impeller clearance/interference
- Radial load calculations

4.2 Performance

4.2.1 Requirements

The pump shall develop its rated pressure when delivering its rated capacity.

The pump shall not exceed 140 percent of its rated pressure at any point along its characteristic curve (pressure vs. flow), including the shutoff point. The shutoff head shall not be less than 99 percent of the maximum head.

The maximum power required shall be determined.

4.2.2 Test/Verification

At least one sample of each rated capacity shall be tested. The minimum and maximum impeller diameters of each impeller design, submitted for Approval, shall be tested to obtain the desired head range(s) for the pump. Intermediate impeller diameters may be tested at the discretion of FM Approvals.

The pump shall be operated at various flow rates to generate total head, power, and efficiency curves. At each flow the total head, power required, and speed shall be measured. A minimum of ten flow readings shall be taken to generate the curve with two of the readings taken at maximum power of the pump. All test speeds must be ± 4 percent of the rated speed. In order to develop characteristic curves, test data shall be corrected to rated speed by means of the affinity relationships. All readings must be witnessed by an FM Approvals engineer.

A total suction head adequate to produce the maximum power requirement for the pump shall be provided. Maximum power is the greatest power required to drive the pump at any point along its characteristic curve, and is defined as the point where a zero slope of the tangents to the characteristic power curve occurs. The maximum power required shall occur when there is no increase in power with an increase in the total suction head at that same flow and speed.

4.3 Suction Lift

4.3.1 Requirement

The pump shall develop at least 65 percent of its rated pressure when operating at a suction lift of at least 15 ft (4.6 m), referred to sea level, and delivering 150 percent of the rated capacity. If mechanical seals are used, they shall not allow air to leak into the pump at any point along the characteristic curve, not including shut-off.

4.3.2 Test/Verification

At least one sample of each rated capacity shall be tested. The minimum and maximum impeller diameters of each impeller design, submitted for Approval, shall be tested to obtain the desired head range(s) for the pump. Intermediate impeller diameters may be tested at the discretion of FM Approvals.

The pump shall be operated with a minimum suction lift of 15 ft (4.6 m), referred to sea level, at various flow rates to generate total head, power, and efficiency curves. A minimum of eight flow readings, all at a suction lift of 15 ft (4.6 m), shall be taken to generate the curve. At each flow the total head, power required, and speed shall be measured. A minimum of three flow readings in close proximity to 150 percent of rated flow, (within ± 10 percent of rated flow from 150 percent of rated flow), shall be taken, with the 150 percent point within the span of these three points. All test speeds must be ± 4 percent of the rated speed. In order to develop characteristic curves, test data shall be corrected to rated speed by means of the affinity relationship. All readings must be witnessed by an FM Approvals engineer.

If the pump is to be FM Approved with mechanical seals for installations that meet the requirements of Section 3 and FM Global Loss Prevention Data Sheet 3-7N, *Stationary Pumps for Fire Protection*, at least one complete minimum 15 ft (4.6 m) suction lift test, referred to sea level, with the mechanical seals installed shall be performed. This test shall be performed with the worst case condition from the calculations in section 3.2.7.2.11.

4.4 Flange and Gasket Tightness

4.4.1 Requirement

No leakage, except at the shaft packing, shall be observed in a 5 minute test when hydrostatically tested at the required pressure.

4.4.2 Test/Verification

A sample casing of each model and material shall be hydrostatically tested to a pressure equal to, or greater than, the sum of the maximum shutoff pressure of the pump plus a maximum allowable suction pressure specified by the pump manufacturer ($P_{\max} + P_{\max, \text{Suction}}$). The maximum shutoff pressure, P_{\max} , is the highest shutoff pressure obtained in testing the range of impeller diameters and speeds submitted for Approval. The test pressure shall be held for five minutes. In no case shall the maximum allowable suction pressure, $P_{\max, \text{Suction}}$, be less than 75 psi (515 kPa), or the leakage test be run at less than 250 psi (1725 kPa). Casing bolts normally provided shall be used for this test.

4.5 Hydrostatic Strength

4.5.1 Requirements

No rupture, cracking or permanent distortion of any part of the pump shall be observed in a 5 minute test when hydrostatically tested at the required pressure.

4.5.2 Tests/Verification

A sample casing of each model and material shall be hydrostatically tested to a pressure equal to, or greater than, twice the sum of the maximum shutoff pressure of the pump plus a maximum allowable suction pressure specified by the pump manufacturer, $2 \times (P_{\max} + P_{\max. \text{ Suction}})$. The maximum shutoff pressure, P_{\max} , is the highest shutoff pressure obtained in testing the range of impeller diameters and speeds submitted for Approval. The test pressure shall be held for five minutes. In no case shall the maximum allowable suction pressure, $P_{\max. \text{ Suction}}$, be less than 75 psi (515 kPa), or the test be run at a pressure less than 400 psi (2760 kPa). Casing bolts normally provided shall be used for this test.

4.6 Endurance Test (Vertically Mounted Pumps Only)

4.6.1 Requirements

The horizontal split-case pump, mounted vertically, shall be operated continuously for 24 hours under the conditions stated in Section 4.6.2, without excessive vibration, loosening of parts (fasteners, etc.), visible distortion of the baseplate, excessive generation of heat in the bearings, or rubbing of the impeller and casing wear rings.

4.6.2 Tests/Verification

A sample pump shall be operated continuously for 24 hours under conditions of maximum bearing thrust loading, (based on calculations provided by the manufacturer). Following the test, the pump shall be disassembled and the impeller and casing wear rings shall be examined for signs of rubbing. A method of ensuring that the pump runs continuously for 24 hours must be provided. All test speeds must be ± 4 percent of the rated speed.

4.7 One Hour Test (Mechanical Seal Pumps Only)

4.7.1 Requirement

No failure of the mechanical seal is permitted when the pump assemblies shown to have the greatest shaft deflection are run as close to zero flow as possible (maximum radial load) for one hour for each available mechanical seal.

4.7.2 Test/Verification

Each type and size of mechanical seal for use with the pump shall be tested for compliance. The pump assemblies selected for this test shall be of the impeller diameter and speed shown to have the greatest shaft deflection by calculation. Calculations shall be submitted for review prior to scheduling testing. The pump shall be run for one hour as close to zero flow (maximum radial load) as possible without boiling the water. In no case shall the discharge pressure be less than 95 percent of the shut-off pressure for the pump under test. No leakage of the mechanical seal is permitted. Subsequently, the pump shall be disassembled and the mechanical seals shall be examined for evidence of wear or other signs of failure of the mechanical seal.

4.8 Test Procedure

Pump testing is normally performed by the manufacturer at his facility. FM Approvals shall witness the testing and obtain copies of the data and calibration certificates. The range of tests to be conducted shall be specified by FM Approvals. Test procedures shall be in accordance with recommendations for centrifugal pumps in accordance with the latest edition of the Hydraulic Institute Standards, *Standard for Centrifugal, Rotary and Reciprocating Pumps* or equivalent national or international standard.

4.9 Additional Tests

Additional tests may be required, depending on design features, results of any tests, material application, or to verify the integrity and reliability of the fire pumps, at the discretion of FM Approvals.

Unexplainable failures shall not be permitted. A re-test shall only be acceptable at the discretion of FM Approvals and with adequate technical justification of the conditions and reasons for failure.

5. OPERATIONS REQUIREMENTS

A quality control program is required to assure that subsequent horizontal split-case centrifugal fire pumps produced by the manufacturer at an authorized location, shall present the same quality and reliability as the specific horizontal split-case centrifugal fire pumps examined. Design quality, conformance to design, and performance are the areas of primary concern. Design quality is determined during the Approval examination and tests, and is covered in the Approval Report. Conformance to design is verified by control of quality and is covered in the Facilities and Procedures Audit (F&PA). Quality of performance is determined by field performances and by periodic re-examination and testing.

5.1 Demonstrated Quality Control Program

5.1.1 The manufacturer shall demonstrate a quality assurance program which specifies controls for at least the following areas:

- Existence of corporate quality assurance guidelines;
- Incoming quality assurance, including testing;
- In-process quality assurance, including testing;
- Final inspection and tests;
- Equipment calibration;
- Drawing and change control;
- Packaging and shipping;
- Handling and disposition of non-conformance materials; and,
- In order to assure adequate traceability of materials and products, the manufacturer shall maintain records of all quality control tests performed, and shall maintain these records for a minimum period of two years from the date of manufacture.

5.1.2 Documentation/Manual

There should be an authoritative collection of procedures and policies. Such documentation shall provide an accurate description of the quality management system while serving as a permanent reference for implementation and maintenance of that system. The system should require that sufficient records are maintained to demonstrate achievement of the required quality and verify operation of the quality system.

5.1.3 Drawing and Change Control

- The manufacturer shall establish a system of product configuration control that shall allow no unauthorized changes to the product. Changes to critical documents, identified in the Approval Report, must be reported to, and authorized by, FM Approvals prior to implementation for production.
- The manufacturer shall assign an appropriate person or group to be responsible for, and require that, proposed changes to FM Approved or Listed products be reported to FM Approvals before implementation. The manufacturer shall notify FM Approvals of changes in the product or of persons responsible for keeping FM Approvals advised by means of FM Approvals Form 797, *Approved Product/Specification-Tested Revision Report or Address/Main Contact Change Report*.
- Records of all revisions to all FM Approved products shall be maintained.

5.1.3.1 The table below has been included as a guide to manufacturers of what is considered to be a significant change to FM Approvals. To facilitate the Approval of significant changes, modifications that fit this category shall be documented by means of a letter stating the change, and requesting a quotation for an Approval examination.

<i>Modification</i>	<i>Description/ Example</i>
Change in speed rating:	<ul style="list-style-type: none"> • The product was originally FM Approved at 3000 rpm and now is to be evaluated at 3550 rpm
Change in Allowed Impeller Sizes:	<ul style="list-style-type: none"> • The product was originally FM Approved for 4 through 5 inch (100 through 125 mm), and now is to be evaluated at 5.5 inch (140 mm)
Addition or relocation of the manufacturing location:	<ul style="list-style-type: none"> • The product was originally FM Approved when made in location A, and now it is desired to make the same product in locations A and B, or in location B only.
Changes to Critical Dimensions:	<ul style="list-style-type: none"> • Modifications that would have an effect on the ability of the product to maintain the same performance as the originally FM Approved product. An example of this would be a reduction impeller size, or casing wall thickness.

- 5.1.3.2 The table below has been included as a guide to manufacturers of modifications which may be submitted on FM Approvals Form 797.

<i>Modification</i>	<i>Description/Example</i>
Change in Company Contact Information:	<ul style="list-style-type: none"> Contact Name, Title, Phone Number, FAX Number, Office Address, Company Name
Updating of Drawings:	<ul style="list-style-type: none"> Minor dimensional changes, or note changes, Re-creation of old drawing on CAD
Change in material or marking:	<ul style="list-style-type: none"> Where new material is superior, or to show proposed new marking

- 5.1.3.3 For the instances where the modification is difficult to categorize, manufacturers are encouraged to contact FM Approvals and to discuss the nature of the proposed change, and how to send the information to FM Approvals. The examples shown in Sections 5.1.3.1 and 5.1.3.2 are based on common examples of modifications as they relate to the manufacture of split-case centrifugal fire pumps.
- 5.1.3.4 FM Approvals, at its sole discretion, shall determine when additional testing is necessary to validate proposed changes.

5.2 Facilities and Procedures Audit (F&PA)

- 5.2.1 An audit of the manufacturing facility is part of the Approval investigation to verify implementation of the quality control program. Its purpose is to determine that the manufacturer's equipment, procedures, and quality program are maintained to insure a consistently uniform and reliable product. Initial inspections of facilities already producing similar products may be waived at the discretion of FM Approvals.
- 5.2.2 Unannounced follow-up inspections shall be conducted at least annually by FM Approvals, or its designate, to determine continued compliance. More frequent audits may be required by FM Approvals.
- 5.2.3 The client shall manufacture the product or service only at the location(s) audited by FM Approvals and as specified in the Approval Report. Manufacture of products bearing the FM Approval's Certification Mark is not permitted at any other locations without prior written authorization by FM Approvals.

5.3 Manufacturer's Responsibilities

The manufacturer shall notify FM Approvals of changes in product construction, design, components, raw materials, physical characteristics, coatings, component formulation or quality assurance procedures prior to implementation of such changes.

5.4 Manufacturing and Production Tests

5.4.1 Test Requirement No. 1 - *Performance Test*

The manufacturer shall performance test 100 percent of production fire pumps, recording flow, total head, speed and power consumed at a minimum of eight points spanning from shut off to beyond 1.5 times rated flow. Speeds shall be within ± 4 percent of the listed speed. In order to develop the characteristic curve, test data shall be corrected to rated speed by means of the affinity relationship. This curve shall be supplied with the pump.

5.4.2 Test Requirement No. 2 - *Leakage Test*

The manufacturer shall test 100 percent of production fire pumps for body leakage to the sum of the pump's shut-off head plus its maximum allowable suction head, ($P_{\text{max.}} + P_{\text{max. Suction}}$), but not less than 250 psi (1725 kPa). The pressure shall be held for a minimum of five minutes with no objectionable leakage (except at the shaft packing), at any joint. Pump casing distortion or leakage is not allowed.

APPENDIX A: Units of Measurement

LENGTH:	in. - “inches”; (mm - “millimeters”) mm = in. x 25.4 ft - “feet”; (m - “meters”) m = ft x 0.3048
FLOW:	gal/min - “gallons per minute”; (L/min - “liters per minute”) L/min = (gal/min) x 3.785
FORCE:	lb _f - “pound-force”; (N - “Newton”) N = 4.44822 x lb _f kg _f - kilogram force”; (N - “Newton”) N = 9.80665 x kg _f
POWER:	hp - “horsepower”; (kW - “kilowatt”) kW = hp x 0.7457
PRESSURE:	psi - “pounds per square inch”; (kPa - “kilopascals”) kPa = psi x 6.895 in. of Hg - “inches of mercury” psi = in. of Hg x 0.491 bar - “bar”; (kPa - “kilopascals”) bar = kPa x 0.01 bar = psi x 0.06895 m of H ₂ O - “meters of water” kPa = m of H ₂ O x 9.81
ROTATIONAL SPEED:	rpm - “revolutions per minute”; (same in SI Units)
TEMPERATURE:	°F - “degrees Fahrenheit”; (°C - “degrees Celsius”) °C = (°F -32) x 0.556
TORQUE:	ft·lb _f - “foot pound-force”; (N·m - “Newton-meters”) N·m = ft·lb _f x 1.356

APPENDIX B: FM Approvals Certification Marks

FM Approvals certifications marks are to be used only in conjunction with products or services that have been Approved by FM Approvals and in adherence with usage guidelines.



FM APPROVED mark:

Authorized by FM Approvals as a certification mark for any product that has been FM Approved. There is no minimum size requirement for the mark, but it must be large enough to be readily identifiable. The mark should be produced in black on a light background, or in reverse on a dark background.



Cast-On FM Approvals marks:

Where reproduction of the FM Approved mark described above is impossible because of production restrictions, use these modified versions of the FM Approved mark. There is no minimum size requirement for the mark, but it must be large enough to be readily identifiable.



FM APPROVED mark With "C" only:

Authorized by FM Approvals as a certification mark for any product that has been evaluated by FM Approvals in accordance with Canadian codes and standards. There is no minimum size requirement for the mark, but it must be large enough to be readily identifiable. The mark should be produced in black on a light background, or in reverse on a dark background.



FM APPROVED mark with "C" and "US":

Authorized by FM Approvals as a certification mark for any product that has been evaluated by FM Approvals in accordance with US and Canadian codes and standards. There is no minimum size requirement for the mark, but it must be large enough to be readily identifiable. The mark should be produced in black on a light background, or in reverse on a dark background.

USAGE GUIDELINES

All FM Approvals certification marks are the sole property of FM Approvals LLC (“FM Approvals”) and are registered or the subject of applications for registration in the United States and many other countries. They are for use only according to these guidelines.

FM Approvals certification marks may be used only on FM Approved products and related product packaging, in advertising material, catalogs and news releases.

Use of FM Approvals certification marks on such material is not a substitute for use of the complete FM Approvals certification mark on FM Approved products and/or product packaging.

No FM Approvals certification mark or aspect thereof may be incorporated as part of a business name, Internet domain name, or brand name/trademark for products/product lines. This includes both design aspects (the FM Approvals “diamond,” etc.) and word aspects (“FM,” “Approved,” etc.). The use of any FM Approvals certification mark as a trademark is strictly prohibited.

The Approval Standard number or class number may not be incorporated as part of a business name, Internet domain name, or brand name/trademark for products/product lines. For example, a company may not say “ABC Company’s 4100 Fire Door is FM Approved”; the proper terminology is, “ABC Company’s Fire Door is FM Approved per Approval Standard 4100.”

FM Approvals certification marks, except for the FM Approvals Quality System Registration mark, may not be used on business stationery/cards/signage because this could mischaracterize the relationship with FM Approvals. Additionally, these items should not reference any FM Approvals certification mark.

Products or services may not be marketed under any mark or name similar to “FM Global,” “FM Approvals” or any of the FM Approvals certification marks. Further, products or services may not be marketed to imply a relationship beyond the scope of any Approval made by FM Approvals.

When an FM Approvals certification mark is used in advertising material or on product packaging, all material must reflect the specific circumstances under which the product was FM Approved. The material must clearly differentiate between products that are FM Approved and those that are not, and may not, in any way, imply a more substantial relationship with FM Approvals.

A company may not reference the intent to submit a product for Approval or the expectation that a company will have a certain product FM Approved in the future. For example, a company may not state, “Approval by FM Approvals pending” or “Approval by FM Approvals applied for.”

FM Approvals certification marks should not be preceded or followed by a qualifier that indicates a degree of certification or acceptability. For example, “exceeds,” “first” or “only” may not be used to qualify any FM Approvals certification mark.

Only original artwork issued by FM Approvals should be used. The FM Approvals certification marks should not be altered in any way other than to resize the artwork proportionately. Unacceptable uses of the marks include, but are not limited to, adding/deleting wording or artwork, reducing the artwork to an illegible size, animation or distortion.

The text of the FM Approvals certification marks may not be translated into any language other than English.

FM Approvals certification marks must appear in a size and location that is readily identifiable, but less prominent than the name of the owner of the certification or the manufacturer/seller/distributor of the certified products.

APPENDIX C: Test Procedures

There are several acceptable methods of obtaining the test data needed. In order to establish uniformity in method selection, the following techniques, based on recommendations by the Hydraulic Institute, are listed below. For more specific information such as test set-ups and the equations needed to compute results from raw data, reference should be made to the "Hydraulic Institute Standards", latest edition.

C.1 Capacity Measurements

C.1.1 Weight

Scale measurements with accuracy of 0.25 percent of full scale shall be obtainable.

C.1.2 Volume

Reservoir measurements with accuracy of 0.5 percent of the reading shall be obtainable.

C.1.3 Venturi

A certified curve showing the calibration of the meter shall be provided. Machined tubes shall be accurate within ± 0.75 percent of the rate of flow. The size of the venturi needed shall be determined by the throat velocity. A maximum of 20 ft/sec (6.1 m/sec) shall be effected at the venturi throat at the rated capacity of the pump.

The accuracy of the venturi meter depends upon its installation within the hydraulic system. The meter shall not be adversely affected by improper flow conditions immediately preceding the venturi tube. Non-uniform velocity distribution or swirling or pulsating flow will affect the value of the coefficient. Table C.1.3 shows the length of straight pipe required ahead of the venturi tube expressed in terms of equivalent diameters.

Table C.1.3 *Straight Pipe Required After Any Fitting before the Venturi Meter in diameters of Pipe*

<i>Fitting</i>	<i>Meter Ratio (Throat to Inlet Diameter)</i>				
	<i>0.4</i>	<i>0.5</i>	<i>0.6</i>	<i>0.7</i>	<i>0.8</i>
One standard short radius elbow	1	2	3	4	6
Two elbows in same plane	2	3	4	6	8
Two elbows in planes at 90° and with straightening vanes	2	3	4	5	7
Standard cast iron flanged reducer	2	5	7.5	10	13
Standard cast iron flanged increaser	1	2	3	4.5	6
Globe valve with straightening vanes	2	4	6	9	12
Gate valve - 0.2 open	2	4	6	9	12
Gate valve - 0.5 open	2	3	4	6	8
Gate valve - full open	0	0.5	1	2	3

Note: A centrifugal pump pumping directly into a venturi meter should have at least 10 pipe diameters of straight pipe between it and the meter. This distance can be reduced if straightening vanes are properly used between the pump and venturi.

C.1.4 Nozzles

A certified curve showing the calibration of the nozzle shall be provided. When ASME long radius flow nozzles are used with an outlet to inlet diameter ratio from 0.2 to 0.7, the tolerance in the rate of flow should not exceed ± 0.75 percent for 3 in. pipe and over. When other nozzles are used with the same specifications listed above, the error should not exceed ± 1 percent of the rated flow. The nozzle size shall be selected so that the maximum velocity does not exceed 20 ft/s (6.1 m/s) at the nozzle throat.

C.1.5 Orifice Plate

A certified curve showing the calibration of a square edged concentric orifice plate shall be provided. The error should not exceed ± 1.5 percent of the reading when using an orifice-to-pipe diameter ratio from 0.10 to 0.80. Ratios outside of these limits should not be used. Preferred orifice to pipe diameter ratios are from 0.20 to 0.60.

To ensure accurate flow measurements, a sufficient length of straight pipe is required preceding and following the orifice plate. The values required expressed in terms of equivalent diameters, are shown in Tables C.1.5 (a) and (b). When “pipe taps” are used, the values shown in Tables C.1.5 (a) and (b) should be increased by 2 diameters.

Table C.1.5 (a) *Straight Pipe Required After Any Fitting before Meter in Diameters of Pipe*

<i>Fitting</i>	<i>Meter Ratio (Throat to Inlet Diameter)</i>						
	<i>0.2</i>	<i>0.3</i>	<i>0.4</i>	<i>0.5</i>	<i>0.6</i>	<i>0.7</i>	<i>0.8</i>
Tee or wye within line flow	6	6	6.5	7	8.5	10.5	14
One elbow, branch flow thru tee or wye, or flow from drum or separator	6	6	6.5	7	9	13	20.5
Globe valve - wide open	9	9	9.5	10.5	13	15	21
Gate valve - wide open	6	6	6	6	7.5	9.5	13.5
Two or more short radius elbows or bends in the same plane	7.5	7.5	8.5	10.5	13.5	18	25
Two or more long radius elbows or bends in the same plane	6	6	6.5	8	11	16	23
Two short radius elbows or bends in different planes	14.5	16	17.5	20.5	24.5	30	40
Two long radius elbows or bends in different planes	7	8	10	12	16	22	33

Note: A centrifugal pump pumping directly into a nozzle or orifice should have at least 10 pipe diameters of straight pipe between it and the meter. This distance can be reduced if straightening vanes are properly used between the pump and nozzle or orifice.

Table C.1.5 (b) *Straight Pipe Required After Meter before Any Fitting in Diameters of Pipe*

<i>Fitting</i>	<i>Meter Ratio (Throat to Inlet Diameter)</i>						
	<i>0.2</i>	<i>0.3</i>	<i>0.4</i>	<i>0.5</i>	<i>0.6</i>	<i>0.7</i>	<i>0.8</i>
Gate valve - wide open	0	0	0	0	0	0	0
Wye	0	0	0	0	0	0	4
Tee	0	0	0	0	0	3.5	4
Expansion joint	0	0	0	0	0	3.5	4
45° Elbow	0	0	0	0	3.5	3.5	4
Long radius elbow or bend	2	2.5	2.5	3	3.5	3.5	4
Regulators, control valves, and partly throttled gate valves	6	6	6	6	6	6	6

C.1.6 Weir

A rectangular sharp crested weir with a smooth vertical crest wall, complete crest contraction, free overfall and with the end contraction suppressed, is a suitable capacity measuring device. The weir should be calibrated in place with the water circuit.

When rectangular suppressed weirs are used, the error shall not exceed ± 2 percent of the flow under the following limitations of flow:

- The head is not smaller than 0.2 ft (61 mm).
- The head is not larger than one-half the height of the weir.
- The head is not larger than one-half the length of the weir.

C.1.7 Electromagnetic Flow Meters

Electromagnetic flowmeters are based on Faraday's Law of Magnetic Induction that states that a voltage will be induced when a conductor, in this case water, moves at right angles through a magnetic field is proportional to the velocity of that conductor - the faster the flow rate, the higher the voltage. This voltage is picked up by sensing electrodes mounted in the meter tube and sent to the transmitter which takes the voltage and calculates the flow rate based on the cross sectional area of the meter tube. Pressure drop across the meter is the same as it is through an equivalent length of pipe because there are no moving parts or obstructions to the flow.

Electromagnetic flow meters shall have an accuracy of ± 0.5 percent of the flow reading.

C.2 Head Measurements

C.2.1 Instruments to measure head shall, when practical, be water columns or manometers and for high pressures shall be mercury manometers, bourdon gauges, electrical pressure transducers or dead weight gauge testers. If water gauges are used, errors due to water temperature difference within the gauge and pump, shall be avoided. Measuring instrumentation shall have records of calibration traceable to national standards. Tolerances shall not exceed ± 1.0 percent of the full scale.

C.2.2 It is important that steady flow conditions exist at the point of instrument connection. For this reason, it is necessary that pressure or head measurement be taken on a section of pipe where the cross-section is constant and straight. Five to ten diameters of straight pipe of unvarying cross-section following any elbow or curved member, valve, or other obstruction, are usually necessary to ensure steady flow conditions.

C.2.3 Special care shall be taken in the drilling of orifice or tap openings for gauges. The following precautions shall be taken:

- The orifice in the pipe shall be flush with and normal to the wall of the water passage.
- The wall of the water passage shall be smooth and of unvarying cross-section. For a distance of at least 12 in. (305 mm) preceding the orifice, all tubercles and roughness shall be removed with a file or emery cloth, if necessary.
- The orifice shall be of a diameter from 1/8 in. to 1/4 in. (3.2 mm to 6.4 mm) and of a length equal to twice the diameter.
- The edges of the orifice shall be provided with a suitable radius tangential to the wall of the water passage, and shall be free from burrs or irregularities.

C.2.4 The datum shall be taken as the centerline of the pump.

C.3 Power Measurements

C.3.1 Pump input power shall be determined by either transmission dynamometers, torsion dynamometers, strain gauge type torque measuring devices, or by the use of calibrated drivers.

C.3.2 When pump input power is to be determined by transmission dynamometers, the unloaded and unlocked dynamometer must be properly balanced, prior to the test, at the same speed at which the test is to be run. The scales should be checked against standard weights.

- C.3.3 When pump input power is to be determined by torsion dynamometers, the unloaded dynamometer shall be statically calibrated prior to the test by measuring the angular deflection for a given torque; the tare reading on the dynamometer scale is taken at rated speed with the pump disconnected.
- C.3.4 When strain gauge type torque measuring devices are used to measure pump input power, they shall be calibrated, with their accompanying instrumentation, at regular intervals.
- C.3.5 When pump input power is to be determined by the use of a calibrated motor, measurements of power input shall be made at the terminals of the motor to exclude any line losses that may occur between the switchboard and the driver itself. Certified calibration curves of the motor must be provided. The calibration shall be conducted on the specific motor in question, and not on a similar machine. Such calibrations must indicate the true input-output value of the motor efficiency and not some conventional method of determining an arbitrary efficiency.
- C.3.6 After the completion of any of the above tests, recalibration or rebalancing shall be checked to assure that no change has taken place. In the event of appreciable change, the test shall be rerun.
- C.3.7 Calibrated laboratory type electric meters and transformers shall be used to measure power input to all electric motors.

C.4 Speed Measurement

- C.4.1 Measurement of speed shall be made by means of revolution counters, tachometers, or stroboscopic devices.
- C.4.2 For speed measurements taken by means of a revolution counter, the timing period shall be of sufficient length to obtain a true average speed. The stopwatch shall be checked against a standard timer. If electric/electronic speed sensing element with electronic counter is used, it shall be checked against a suitable secondary frequency standard.
- C.4.3 When a tachometer is used, it shall be calibrated against a revolution counter before and after the test. Tachometer readings shall be made at frequent intervals during the period each test reading is taken to determine an accurate measurement of average speed over that reading period.
- C.4.4 When a stroboscopic device is used, the comparison frequency source shall be either line frequency, where stable, or a stable independent frequency. The speed shall be determined by the observation and deduction of slip from the synchronous speed.

C.5 Time Measurement

Time measurement with accuracy of 1/100 of a second shall be obtainable.

APPENDIX D: Fire Pump Unit (Packages)

The fire pump package consists of the following components which are furnished by the pump manufacturer or his authorized representative, when available FM Approved components shall be supplied:

1. Split-case centrifugal fire pump
2. Controller, electric motor or diesel engine as appropriate
3. Driver and accessories (including batteries)
4. Flow meter or hose header and hose valves
5. Suction and discharge pressure gages and connections
6. Pressure-relief valve, when required, and waste cone, when required
7. Automatic air release valve
8. Eccentric suction reducer
9. Concentric increaser
10. Ball drip, when required
11. Circulation-relief valve
12. Substantial bedplate for pump and driver
13. Pressure recorder
14. Rigid engine cooling water and fuel lines (May have short flexible elements in close proximity to engine to minimize vibration)
15. Spare parts
16. Instruction, Operation and maintenance manual in local language
17. Spare mechanical seal

Additional equipment (where needed) which may be supplied by the manufacturer or the purchaser:

1. Suction OS&Y valve
2. Discharge valve
3. Hose-connection valve
4. Discharge check valve
5. All piping connections
6. Suction screen to suit requirements
7. Wiring and power connection for electric motor or diesel engine controller
8. Pipe connections to steam turbine
9. Cooling-water overflow connection for internal-combustion engines
10. Discharge elbow or tee
11. Reducing tees or elbows
12. Exhaust piping and muffler for diesel engine
13. Fuel tank for diesel engine


APPENDIX E: Tolerance

Unless otherwise stated, the following tolerances shall apply:

Flow	+ 1/- 0 percent of value
Frequency (Hz):	± 5 percent of value
Length:	± 2 percent of value
Volume:	± 2 percent of value
Volume Per Unit Area:	± 5 percent of value
Power	± 1.5 percent of value
Pressure:	± 0.5 percent of value
Speed	± 0.3 percent of value
Temperature:	± 4°F (2°C)
Time:	+ 5/-0 seconds +0.1/-0 minutes

Unless stated otherwise, all tests shall be carried out at a room (ambient) temperature of $68 \pm 9^{\circ}\text{F}$ ($20 \pm 5^{\circ}\text{C}$).


APPENDIX F: Figures

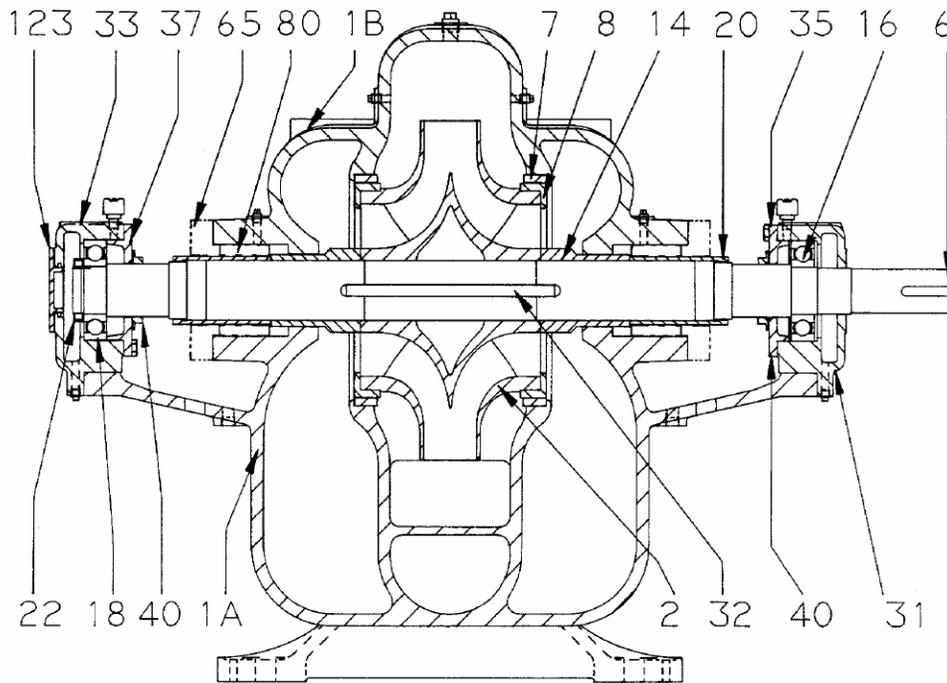

Provided courtesy of the Hydraulic Institute, Parsippany, NJ www.pumps.org

MECHANICAL SEAL CONSTRUCTION (Shown)			
1A	Casing, lower half	22	Locknut
1B	Casing, upper half	31	Housing, bearing inboard
2	Impeller	32	Key, impeller
6	Shaft	33	Housing, bearing outboard
7	Ring, casing	35	Cover, bearing inboard
8	Ring, impeller	37	Cover, bearing outboard
14	Sleeve, shaft	40	Deflector
16	Bearing, inboard	65	Seal, mechanical stationary element
18	Bearing, outboard	80	Seal, mechanical rotating element
20	Nut, shaft sleeve	123	Cover, bearing end
PACKING SEAL CONSTRUCTION			
(All above Components except #65 and 80 Plus below Components)			
	Packing		Packing Gland
	Lantern Ring		Stuffing Box Bushing
	Seal Piping		

Figure F-1. Axial Split-Case Centrifugal Fire Pump (Shown with Mechanical Seals)

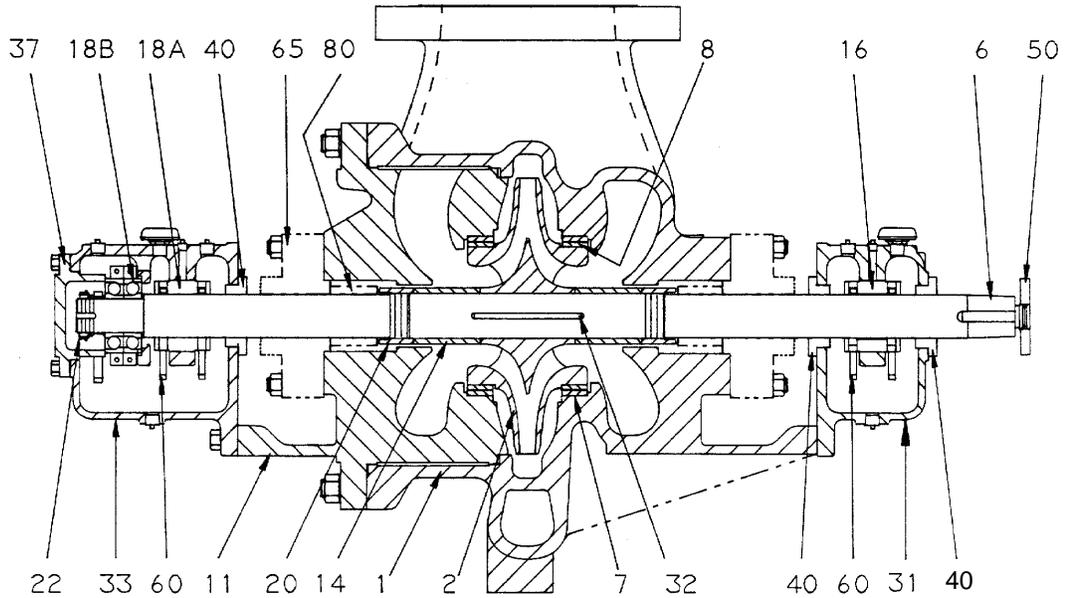

Provided courtesy of the Hydraulic Institute, Parsippany, NJ www.pumps.org

MECHANICAL SEAL CONSTRUCTION (Shown)			
1	Casing	22	Locknut, bearing
2	Impeller	31	Housing, bearing, inboard
6	Shaft	32	Key, impeller
7	Ring, casing	33	Housing, bearing, outboard
8	Ring, impeller	37	Cover, bearing, outboard
11	Cover	40	Deflector
14	Sleeve, shaft	50	Locknut, coupling
16	Bearing, inboard, sleeve	60	Ring, oil
18A	Bearing, outboard, sleeve	65	Packing Gland or Seal, mechanical, stationary element
18B	Bearing, outboard, ball	80	Packing and Lantern Ring or Seal, mechanical, rotating element
20	Nut, shaft sleeve		
PACKING SEAL CONSTRUCTION			
(All above Components except #65 and 80 Plus below Components)			
	Packing		Packing Gland
	Lantern Ring		Stuffing Box Bushing
	Seal Piping		

Figure F-2. Radial Split-Case Centrifugal Fire Pumps (Shown with Mechanical Seals)

APPENDIX G: Sample Listing

PJM Pump Company, 15 ABC Road, Halifax, RI 02866

<i>Rated Capacity, gal/min (dm³/min)</i>	<i>Rated Net Head, psi(kPa)</i>	<i>Rated Speed, r/min</i>	<i>Type Designation</i>	<i>Suction Inlet, dia., in.</i>	<i>Discharge Outlet, dia., in.</i>	<i>Stage</i>
250 (945)	41 - 96 (285 - 660)	2600	5x4x5JMM	5	4	1
500 (1895)	60 - 117 (415 - 805)	2800	6x5x10GLM	6	5	1
750 (2840)	82 - 165 (565 - 1140)	3000	6x5x12SDM	6	5	1
1000 (3785)	273 - 303 (1880 - 2090)	2950	8x6x12PJM	8	6	2
1250 (4730)	51-98 (350 - 675)	1450	10x8x10ACM	10	8	1



FM ApprovalsSM

Member of the FM Global Group